

Demand-Controlled Ventilation in Multi-Story, Multi-Residential Buildings

The case for using demand-controlled ventilation to save energy and improve comfort



WHITE PAPER SUMMARY

This paper discusses the benefits of demand-controlled ventilation (DCV) systems in multi-story, multi-residential buildings which include improving building energy efficiency, enhancing comfort and other key performance factors.

DCV has a significant history of use in multi-story, multi-family buildings. This paper reviews the application of DCV in new, retrofit and renovated building projects, and discusses the significant benefits associated with such practices – in particular, for high-performance ventilation, energy savings and comfort.

DCV is ideally suited for vertical subdivisions due to ease of installation and compliance with the latest building codes, particular those related to multi-story clothes dryer exhaust. More importantly, DCV enhances high-performance ventilation, as a result of quiet operation, reduced uncontrolled air infiltration and exfiltration – which can lead to improved indoor air quality (IAQ) – and substantial energy savings from reduced volumes of conditioned air exhausted and lower fan operating cost.

In terms of cost, a fixed speed ventilation system used with a clothes dryer can exhaust close to \$800 of conditioned air annually, while a DCV system only exhausts \$250. Similar differences can be found for bathroom and kitchen exhaust systems. Actual savings depend on location.

This paper will examine general principles and recommended practices for selecting and designing

DCV systems. We also review saving models that can be used to determine possible energy savings and ROI on retrofit projects.

In addition, an outline of performance expectations, such as durability, energy efficiency, sustainability considerations, and maintenance requirements is presented. We also present several case studies that highlight the real-world track record of DCV.

Properly specified and applied, DCV is shown to provide significant benefits for new construction and renovation projects.

Content

Introduction	2
Typical local ventilation systems	2
Establishing a model to quantify energy savings in local ventilation applications	4
Tips for designing a DCV system	7
Example of savings from DCV systems	8
Other economic factors to consider	9
Guidelines for estimating potential savings on a particular project	10
Explanation of Components in DCV systems	10
Life-Cycle and Maintenance Benefits of DCV	12
DCV Lifetime Return	12
Sustainability and DCV	13
DCV and Grants and Incentives	14
Special Building Code Considerations	14

Introduction

Ventilation strategies for multi-story, multi-residential buildings (“vertical subdivisions”) are covered by the requirements for mechanical ventilation outlined in the American Society of Heating, Refrigeration and Air-Conditioning Engineers (ASHRAE) Standard 62.1. In recent years ventilation strategies have aimed to reduce the overall energy use of the building and to create a healthier, stimulating environment for the building’s occupants.

For many years ventilation strategies have included constant outside air and economizer operation. Demand control ventilation is a relatively new concept. It has been around for decades and was pioneered in Europe where high energy prices created a natural market. Today, DCV systems are often associated with indoor pollutant control, where the pollutant is CO₂, and CO₂ level control is the preferred method of control.

The three strategies outlined above are the most commonly used, but there is another strategy that tends to be overlooked: local ventilation. “Local Ventilation” is covered by ASHRAE Standard 62.1 (see Fig. 1):

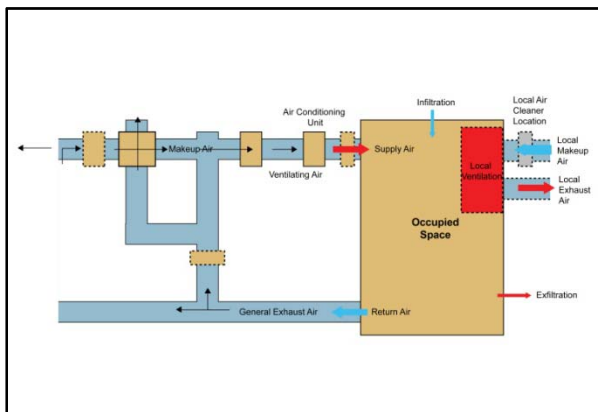


Fig 1: Building Ventilation system showing location ventilation (ANSI/ASHRAE Standard 62.1 – 2007)

Typical applications are bathroom and kitchen ventilation, clothes dryer ventilation and ventilation and exhaust from boilers and mechanical rooms. The potential for energy savings in these applications is substantial, but designers often don’t

consider this in calculating the building’s life cycle. And yet, they take “local” exhaust air volumes into consideration when determining building air supply rates. Fact of the matter is that local ventilation only exhausts conditioned air from a building and works against reducing energy usage. Thus it is very difficult to include local ventilation in efforts to recover energy because the exhaust can be contaminated with odor, grease, lint etc.

Typical Local Ventilation Systems

We will look at three typical local ventilation systems: ventilation from clothes dryers, kitchen hoods and bathrooms.

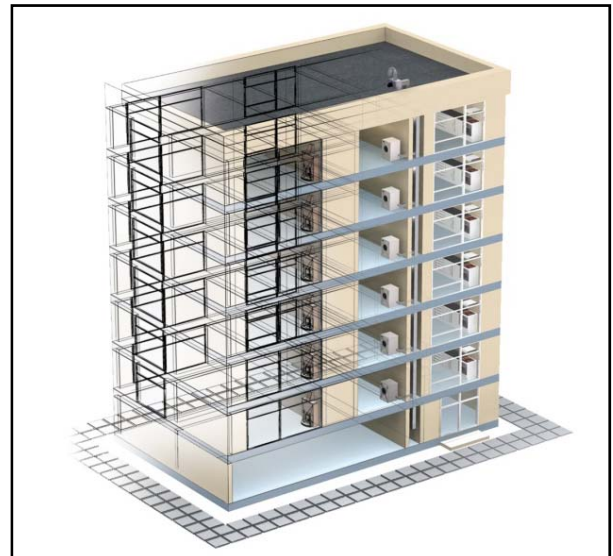


Fig. 2: Typical multi-story, multi-family appliance setup

The applications are very similar and the ventilation or exhaust can be provided in one of three ways:

1. **Exhaust via individual and mostly horizontal ducts to the outside of a building.** The driving force is either a fan integrated in the appliance or/and an external booster fan that is interlocked with the appliance operation. (see fig. 3)

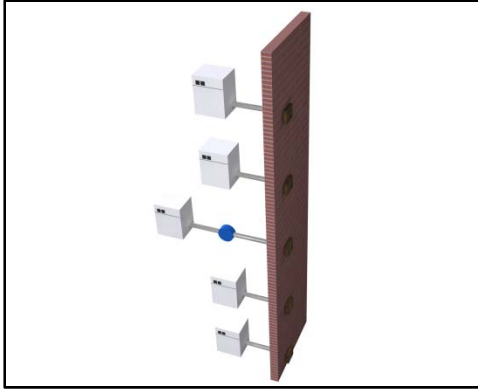


Fig. 3: Direct to the outside exhausted clothes dryers

2. **Exhaust via a vertical shaft where each appliance is connected to a common vertical duct.** As required by the building codes a common fan (scavenger fan) exhausts the common duct 24/7 at a constant speed and exhaust rate. If all appliances are idle, replacement air is drawn from a damper at the bottom of the shaft and through each connected appliance. The purpose of the damper is to reduce the amount of conditioned air exhausted from the living space when the appliance is idle. (see fig. 4)



Fig. 4: Common shaft with constant speed exhaust system

3. **Exhaust via a vertical shaft where each appliance is connected to a common vertical duct.** As required by the building codes a common fan exhausts the common duct 24/7 but at a variable speed and exhaust rate that matches the demand. If all appliances are idle, the replacement air

requirement is usually so limited that it can be drawn through each connected appliance. It can be considered trickle ventilation with a very small energy loss. (see fig. 5)

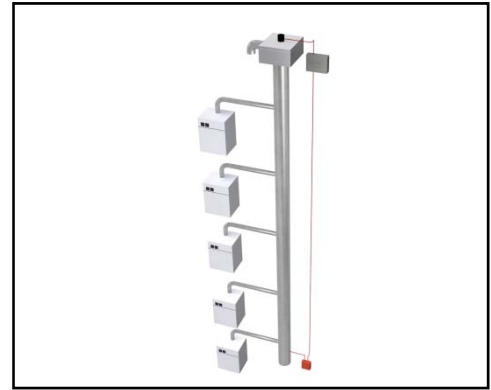


Fig. 5: Common shaft with DCV system

When utilizing 'direct-to-outside' exhaust systems each appliance must have its own designated duct and booster fan. In a 10 story building this could add up to more than 100 boosters. Maintenance can be difficult and time consuming, especially for dryer venting systems. Lint or grease built-up on the outside wall can be difficult to remove or clean.

Often the distance to an outside wall is excessive or it is simply impossible to reach through a duct system. Or, it is considered too expensive to install and connect individual ducts with booster fans. Or, the booster fan is considered too noisy. In these situations a common ventilation system is usually considered.

A common exhaust system must be ventilated by a fan that operates continuously. This is clearly stated in current building codes. The fan serves two purposes. It assures that whenever an appliance is used it is also being exhausted, and it directs the flow of a potential fire to the outside. For fire safety, each appliance's duct connection into the common duct must have a sub-duct installed (see fig. 6). The sub-ducts prevent a potential fire to spread to other stories.

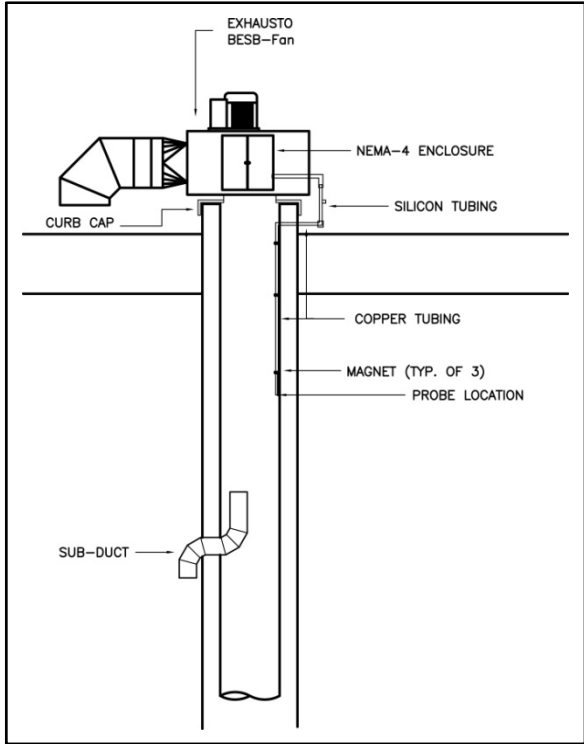


Fig. 6: Common shaft with sub-duct

When utilizing a common exhaust system it is unlikely that all users use all the appliances simultaneously. This means diversity factors can be applied to the duct design, saving space, materials and labor.

Common exhaust systems, like all location ventilations systems, have the potential for significant energy loss. A traditional system with an exhaust fan operating at full speed 24/7 can exhaust huge amounts of conditioned air. It only takes a visit to the rooftop to observe the exhaust flow – nice and cool in the summer and nice and warm in the winter – to realize energy is being lost.

This table shows some typical exhaust rates for the appliances:

Typical Exhaust Rates	
Clothes Dryer	150-200 CFM
Bathrom vent	50-100 CFM
Kitchen hood	150-500 CFM

Table 1: Typical Appliance Exhaust Rates

Take the example of a 10 story building with four apartments per floor using a single fan for each of the three applications. That would add up to 40 x 175 CFM for the dryers, 40 x 75 CFM for the bathrooms and maybe 40 x 250 CFM or a total of 10,000 CFM. If the appliances are only used 30% of the time, the excess exhaust of conditioned air would be 7,000 CFM or 10,080,000 cubic feet per day!

It seems obvious that there is a huge savings potential if using a DCV system.

But why not use a single speed fan with a relief damper?

The challenge in exhaust systems in multi-story buildings is avoiding negative pressure zones on the top floors of the building. That means that the pressure drop in the vertical shaft must be very low (0.1-0.2" WC). So, if the shaft is connected to a relief damper to the outside via a horizontal duct this duct can't have any pressure drop. This makes it fairly large and costly.

You cannot pull air from a parking garage, because usually operates under negative pressure.

If the vertical shaft has a relief damper it is still conditioned air that is being pulled in most cases.

Establishing a Model to Quantify Energy Savings in Local Ventilation Applications

It's difficult to quantify the energy savings associated with a DCV system. However, recent studies in Canada have devised a calculation tool for clothes dryers than can also be used for kitchen and bathroom exhaust systems.

A project by the Natural Gas Technologies Centre, Montreal¹, on behalf of Enbridge Gas Distribution² regarding the cost-effectiveness of switching from electric to natural gas-fired dryers discovered that there is a great potential for energy savings in vertical subdivisions and their laundry facilities. The data was collected from information in the open literature, laboratory test performances, and

monitoring of laundries located in the greater Toronto area.

The main objective of the on-site monitoring that took place from September 17, 2006 through December 6, 2007 was to characterize the operation of multi-residential building laundry rooms and to document the changes associated with the conversion of electric clothes dryers to natural gas-fired dryers while taking into account, the redesign of the dryers' exhaust system into a DCV system. Based on more than 35,000 hours of monitoring performed, it was noted that eight dryers located in the laundry rooms of a multi-residential building operate on average of 1,300 minutes per week or 185 minutes per day (average); 16 hours per day (70% of the time), none of the monitored dryers were used. Further, it was determined that all dryers only operated simultaneously an average of 22 minutes per day (see figure below).

Laundry Utilization Profile		
% Dryers in Operation	Laundry Profile (% per day)	Laundry Profile (minutes per day)
100	1.5	22
75	3.9	56
50	8.6	124
25	16.7	240
0	69.3	998
Total	100	1,440

Table 2: Laundry utilization profile for 8-dryer laundry system

This utilization profile has a great influence on the potential annual building heating/cooling energy savings. The fact that dryer operation averages less than 30% of the time represents a great opportunity to save energy through the installation of an appropriate demand control exhaust system.

In the laundry facilities, the dryers' exhaust was collected in a plenum and vented to the outside by means of a single speed fan running 24 hour per day. The effect of using a variable-speed drive common exhaust fan, as opposed to a single-speed

drive fan, was studied by conducting tests on a banks of multiple gas-fired and electrical dryers (see Fig. 7).

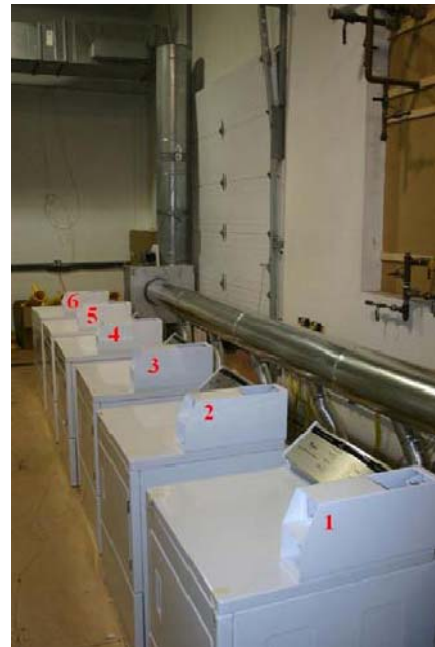


Fig . 7: Test system setup

Some of the key results indicated that inducing an excessive vacuum at the dryer outlet, as is the case when the exhaust fan is not properly sized, could contribute to increasing a dryer's energy consumption by 2-8%. Also, using a demand control ventilation system (MDVS control system) has limited impact on drying time but could significantly contribute to a decrease in dryers' energy consumption by 3%, while preventing up to **10 times** more conditioned air than necessary being exhausted. When dryers are commonly exhausted using a single-speed exhaust fan that is designed to remove 200 CFM per dryer at all times, the loss of conditioned air to the outside is estimated to be around 288,000 ft³/day/dryer. In comparison, by using a DCV system with fan speed control in response to the number of dryers in operation, the

loss of conditioned air is greatly reduced to 41,000 ft³/day/dryer.

All in all, more than 18 tests were performed in NGTC's laboratory to study the effect of a common exhaust system control strategy on drying time and energy consumption of a bank of six dryers. The main objective was to compare the use of a variable-speed drive fan, which modulates its speed depending on the number of dryers in operation, to that of a constant-speed exhaust fan running continuously at its nominal capacity. With this in mind, a rule of thumb was developed to estimate the heating and cooling costs associated with the use of a single-speed exhaust fan. Note that when a common exhaust strategy is retained, additional energy savings could be achieved through exhaust fan modulation capability. This was demonstrated by a 8,800 kWh/year electricity savings for the fan alone at sites that were part of the study.

Based on the previously described utilization profile of a multi-residential building laundry facility, it was estimated that 248,000 ft³ (7,000 m³) of conditioned air per dryer (200 CFM unit) per day is unnecessarily evacuated to the outside when using a single-speed exhaust fan versus a variable-speed drive exhaust fan. The following table describes the calculation assuming single-speed exhaust fans are designed to constantly exhaust 200 CFM per dryer, even when there are no dryers in operation.

Conditioned Air Savings				
Laundry Utilization Profile		Conditioned Air Loss to Outside (cu.ft. per day per dryer)		
% Dryers in Operation	Laundry Profile (% per day)	DCV	Constant Speed	Savings
100	1.5	2,649	2,896	247
75	3.9	5,050	8,652	3,602
50	8.6	7,451	21,613	14,161
25	16.7	10,559	43,190	32,631
0	69.3	14,091	211,678	197,587
Total	100	39,800	288,678	248,229

Table 3: Utilization Profile and Conditioned Air Savings

For an easier understanding of the utilization profile, it can be expressed graphically like this:

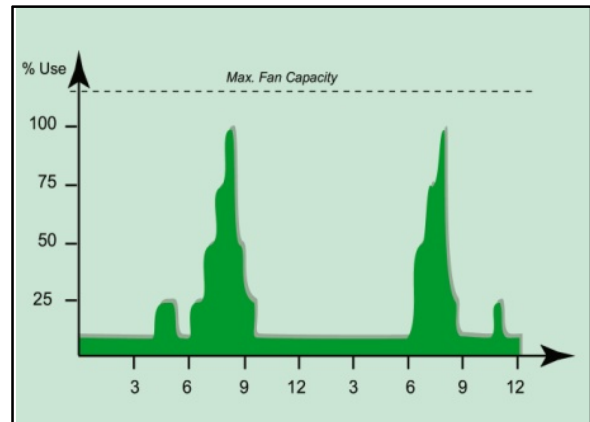


Fig. 8: Utilization Profile (graphic view)

The loss of conditioned air versus the number of dryers in operation can be seen in the following tables. It is clear that the loss of conditioned air is far higher without a demand controller (see fig. 5) than with controller (see fig. 4).

Conditioned Air Savings (laboratory results)			
Air flow - DCV Control ON (cu.ft. per min)			
Dryers in Operation	Air flow per dryer	Air flow in main duct	Loss of air
1	120	197	77
3	118	337	0
6	115	624	0

Table 4: Loss of conditioned air vs. number of dryers in operation and DCV control ON (laboratory results)

Conditioned Air Savings (laboratory results)			
Air flow - DCV Control OFF (cu.ft. per min)			
Dryers in Operation	Air flow per dryer	Air flow in main duct	Loss of air
1	131	1,215	1,084
3	127	1,237	856
6	117	1,221	519

Table 5: Loss of conditioned air vs. number of dryers in operation and DCV control OFF (laboratory results)

In order to calculate the potential energy savings, the heating and cooling factors (0.23 and 2.3) were derived from the following equations⁷.

$$Factor_{heating} = \frac{Lost_{air} \times Density_{air} \times Cp_{air}}{HHV_{gas}} = \frac{7,000 \frac{m^3}{day} \times 1.2 \frac{kg}{m^3} \times 1.0 \frac{kJ}{kg \cdot C}}{36,500 \frac{kJ}{m^3}} = 0.23 \frac{m^3_{air}}{C \cdot day}$$

$$Factor_{cooling} = \frac{Lost_{air} \times Density_{air} \times Cp_{air}}{Factor_{conversion}} = \frac{7,000 \frac{m^3}{day} \times 1.2 \frac{kg}{m^3} \times 1.0 \frac{kJ}{kg \cdot C}}{3,600 \frac{kJ}{kWh}} = 2.3 \frac{kWh}{C \cdot day}$$

The equations above are based on the fact that approximately 248,000 ft³ of conditioned air per day could be saved when using a variable-speed drive exhaust fan that is able to adjust its output depending on the number of dryers operating at the time. Invariably, there is much savings associated with the installation of a DCV system. Since exhaust fans are usually sized for the maximum flow rate when all the dryers are in operation and as discussed previously, all dryers very rarely operate simultaneously; a single-speed exhaust fan is in more cases, oversized. In comparison, a DCV system that is able to adjust its output speed depending on the number of dryers in operation is more cost efficient. One could apply the following equations⁷ to estimate the heating and cooling costs associated with the use of a single-speed exhaust fan.

$$Lost_{heating} \left(\frac{m^3_{gas}}{year} \right) = \frac{DD_{heating} \cdot Nb_{dryers}}{\epsilon_{heating}} \times 0.23$$

$$Lost_{cooling} \left(\frac{kWh}{year} \right) = \frac{DD_{cooling} \cdot Nb_{dryers}}{\epsilon_{cooling}} \times 2.3$$

For example, for a 15-dryer laundry room located in Toronto, assuming the average annual efficiency of the heating system is 80% and, the coefficient of performance for the cooling system is 7.00 (~700% efficiency), then the cost associated with the loss of conditioned air from the use of a single-speed exhaust fan can be calculated (see equation⁷ below).

$$Lost_{heating} = \frac{4,066 \cdot 10}{80\%} \times 0.23 = 11,700 \frac{m^3_{gas}}{year}$$

$$Lost_{cooling} = \frac{252 \cdot 10}{700\%} \times 2.3 = 800 \frac{kWh}{year}$$

Note that the equations above are valid when; the utilization profile resembles the one illustrated previously, the single-speed exhaust fan being replaced is designed to exhaust 200 CFM per dryer 24 hours a day, and the laundry room is conditioned to 65°F year-round. In addition to the energy savings associated with the loss of conditioned air, significant savings can be had by using a variable-speed drive exhaust fan. It was observed that the single speed fan system running at full speed consumed 1,300W continuously as opposed to only 150W for a properly designed system utilizing a variable-speed drive exhaust fan in a demand control ventilation system. This corresponds to an annual savings of 8,800 kWh.

The Canadian study is significant because some of the results can be used in determining operating, heating and cooling losses, not only for dryers in laundry facilities, but also for multi-story clothes dryer and kitchen and bathroom applications.

Tips for Designing a Demand Controlled Ventilation System

DCV systems can be used both in new construction and for retrofitting. New construction offers more

design flexibility and the potential for space and materials savings, but the potential for energy saving is virtually identical.

The details of a DCV system design won't be described here. However, we must consider some factors that have a major impact on the cost of operation.

By determining a utilization profile for a system, it is possible to establish a diversification factor. The diversity factor refers to the max. demand compared to the max. system capacity. A 70% diversity factor means that the total load will never exceed 70% of the maximum system capacity.

Fig. 9 has been designed from information in the open literature, and over 20 years of monitoring of multi-appliance ventilation system:

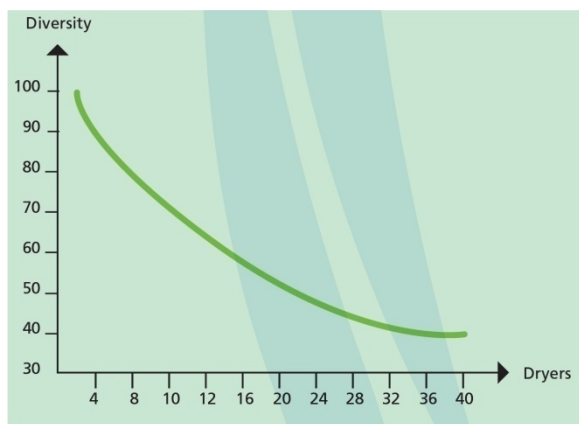


Fig 9: Diversity factor vs. number of dryers served

The diversity factor can be used when designing the common exhaust duct and will result in a smaller duct compared to a design where the maximum capacity is considered. This will reduce space taken up by the duct and reduce the cost of labor and material for installation.

However, please note that the diversity factor can't always be used to reduce fan capacity. Some building codes or local jurisdictions will not allow this. When a diversity factor is not allowed as a means to reduce the fan capacity, the fan system must be designed to handle the total CFM of the appliances and overcome the total pressure within the exhaust system.

The utilization profile shown in Table 6 should be considered a conservative "worst-case-scenario". With regard to kitchen and clothes dryer exhaust, the profile is likely dependant on occupancy levels. High-income households may reduce the utilization profile. Profiling bathroom usage depends on occupancy level as well.

Laundry Utilization Profile		
% Dryers in Operation	Laundry Profile (% per day)	Laundry Profile (minutes per day)
100	1.5	22
75	3.9	56
50	8.6	124
25	16.7	240
0	69.3	998
Total	100	1,440

Table 6: Utilization profile for shaft

Example of Savings from Demand Controlled Ventilation Systems

The following example is from an actual retrofit job in the State of Maryland:

There is a total of 14 identical shafts in the condominium building. Each shaft is exhausting nine kitchen hoods – one on each floor of a nine-story building – with an exhaust fan mounted at the termination.

The original installation used a traditional constant speed exhaust fan to exhaust the kitchen hoods but the home owner association (HOA) received numerous complaints about fan noise and was concerned about the large amount of conditioned air exhausted through the kitchen hoods when not in use. The HOA heard about the DCV system, but it had concerns about the cost of the retrofit. The controls required to vary the exhaust rate can make a DCV system more expensive to acquire compared to a standard constant speed exhaust system.

The original design showed a need for a total exhaust volume of 1,560 CFM per shaft, which was

used to determine the estimated annual savings after installing a DCV system. Based on the estimated utilization profile, the cooling/heating degree days and the efficiency of the cooling and heating equipment (see Table 7), the calculation results are found in Table 8:

Assumptions		
	Heating	Cooling
Energy Cost	\$1.20 / Therm	\$0.10 / kW
Heating/Cooling Degree Days	3,999	1,560
Heating Efficiency/ Cooling Efficiency	80%	7.00

Table 7: Energy cost, degree days and equipment efficiency used for calculations.

Annual Savings per Shaft	Total per Year
Energy Savings (Fan Power Consumption)	\$812
Energy Savings (Loss of Conditioned Air)	\$2,235
- Heating	1,685 Therms
- Cooling	2,127 kW
Total Annual Energy Savings	\$3,046

Table 8: Calculated savings for a single shaft with nine kitchen hoods and 1,560 CFM of exhaust flow.

With a total number of 14 shafts, the estimated annual savings amounted to \$42,644.

After installing a DCV system, the calculations were run again based on measured exhaust data. When no kitchen hoods were in use and the demand control ventilation system was idle the exhaust flow was approx. 140 CFM of conditioned air – or less than 10% of the design volume. This is about approx. 15 CFM per condominium.

During full operating load it was determined that the exhaust volume was only 1,300 CFM. With this information a new calculation was made which gave the following results:

Annual Savings per Shaft	Total per Year
Energy Savings (Fan Power Consumption)	\$812
Energy Savings (Loss of Conditioned Air)	\$1,944
- Heating	1,466 Therms
- Cooling	1,850 kW
Total Annual Energy Savings	\$2,756

Table 9: Calculated savings for a single shaft with nine kitchen hoods and 1,300 CFM of exhaust flow.

The estimated annual savings for the 14 shafts totaled \$38,584.

The cost of 14 DCV systems amounted to approx. \$55,000 while the installation cost amounted to approx. \$16,000. With a total project cost of \$71,000 the estimated payback was 22 months. The estimated simple 5-year return on investment (ROI) was 172% or 34% per year.

Payback Period						
	Initial Investment	Year 1	Year 2	Year 3	Year 4	Year 5
DCV Investment	71,000					
Savings Each Year	0	38,584	38,584	38,584	38,584	38,584
Cumulative Pre-interest Pre-tax Payback	-71,000	-32,416	6,168	44,752	83,336	121,920
Payback Period in Years		1.8				

Table 10: Calculated payback for the retrofit job

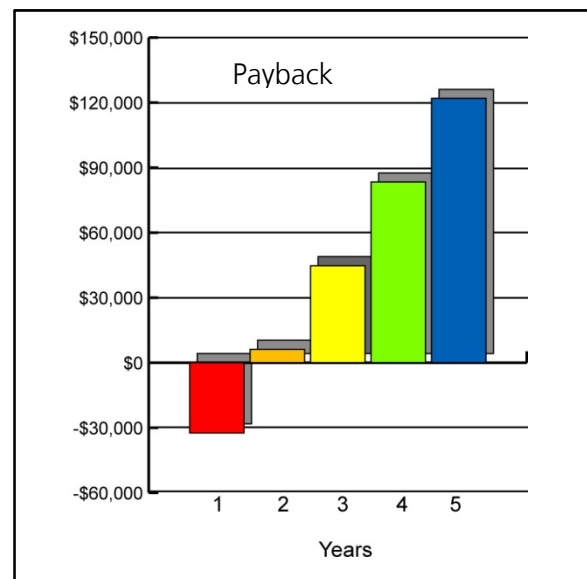


Fig. 10: Calculated payback for the retrofit job

Upgrading from a constant volume system to a DCV system proved to be an excellent investment for the HOA.

Other Economic Factors to Consider

Both in new construction and in the retrofit market, there are economic factors to consider in addition to operational and energy savings.

It is obvious that a reduction in the air exfiltration reduces the need for conditioned air infiltration. This will reduce the load on heating and cooling equipment which can be reduced in size and result in further cost savings.

In some projects, the bathroom, kitchen and clothes dryer exhaust streams have been channeled through enthalpy heat recovery wheels. However, with an efficiency rating of 60-80% this is a much less efficient solution than efficiently controlling the exhaust rate.

Specifying DCV systems in new construction offers more design flexibility and potential for space and materials savings. It is obvious that applying a diversity factor is almost a requirement as this will provide material and labor savings related to the installed cost of the smaller shaft.

Using a central DCV system vs. individual “direct-to-outside” vents can eliminate aesthetic issues such as the need for expensive architectural termination caps on the outside wall. Installation is simpler – it’s one fan vs. multiple fans with individual dryer interlock (required by building codes). It’s also less difficult to maintain, unlike wall-mounted system which can be difficult to clean.

One should not ignore space savings either. Reducing shaft sizes can increase usable building space which can now be sold or rented. In a seven story building, reducing a shaft by 15% can represent as much as \$3,000 in space cost.

DCV is perfect for retrofit projects. Because duct and fan connections and electrical power are already present, the only real challenges are integrating the exhaust fan controller and the pressure sensing devices. In most cases the

controller can be installed near or on the fan. The pressure sensing device that is essential for the demand controlled fan speed modulation, can be installed as shown in Fig. 11:

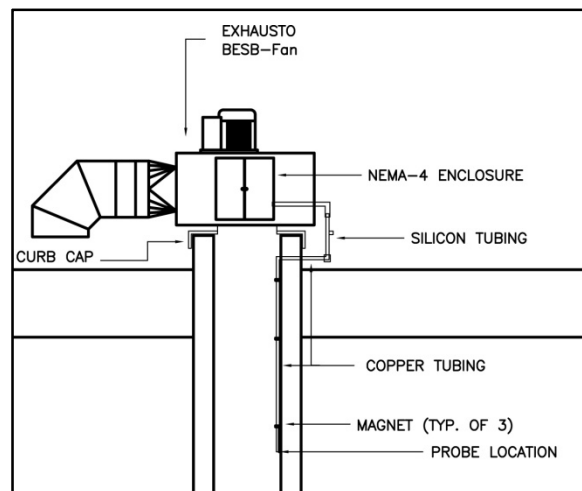


Fig. 11: Pressure sensor probe location in a typical retrofit installation.

Guidelines for Estimating Potential Energy Savings on a Particular Project

The following procedure can be used to estimate energy savings when you replace a constant exhaust volume system with a DCV system:

Estimate exhaust flow from appliances connected to the common duct. Locate a common shaft and its exhaust fan. If possible, measure the air flow in the duct. If that’s not possible, measure the air flow at the fan exit point. You can do this by using an anemometer to measure average fan exit velocities (FPM) and multiply it by the fan opening size (Ft²). By multiplying the two values the air flow can be determined (CFM).

Determine utilization profile. If an actual utilization study is not available, use the profile found in table 5.

Determine heating and cooling days for the location. They can be found online at <http://www.weatherdatadepot.com/dd.asp>.

Calculate estimated energy savings from exhausting less conditioned air. Use the energy savings formula

with actual heating and cooling degree days for the location to calculate the annual energy losses from exhausting conditioned air

Calculate savings from reduced fan operation. Data may be available from the fan or motor manufacturer.

With the results, you can estimate return on investment and payback when utilizing a DCV system over a constant speed system.

Explanation of Components in DCV Systems

No two DCV systems are identical, so it is very important to review and evaluate the components. A DCV system should be fast and responsive and must be able to maintain a set-point with great accuracy and repeatability.

A DCV system usually consists of the following components:

- An exhaust fan
- A variable speed controller
- A controller that monitors the exhaust demand via a pressure sensor and communicates with the variable speed controller or directly with the exhaust fan.
- A pressure sensor that senses shaft pressure changes, which are indications of demand changes.

Exhaust Fan. The exhaust fan must be a true variable speed fan with a direct drive. Belt-driven fans are not suitable for modulating operation as speed variations add wear and tear to the belt. Noise is also a factor if belt-driven fans are used. It's important that the fan is equipped with a true variable speed or inverter-duty motor. If not, the life expectancy is greatly reduced. Direct-drive motors are generally more reliable and require less maintenance.

It's worth noting that the 2009 International Building Code prohibits the use of fans with motors located within the airstream for multistory clothes dryer installations.

Variable speed controller. The controller can be of a frequency drive design or a triac-based design. Most controllers are very basic with limited programming options. They can be connected and controlled directly with a pressure sensor, but it is not an optimal solution. This is explained further below. Triac-based solutions are mainly used with single phase 120VAC fans.

Pressure controller. As variable speed controllers don't have many programming options, a DCV system should be based on a pressure controller. This controller is specifically designed to work with an external pressure sensor and communicate with a frequency drive or directly with a fan. It has a number of programming options and may be interlocked with the appliance operation. The PID loop is specifically designed for smooth and accurate operation – something that is difficult or impossible to obtain with a standard variable frequency drive.

Pressure sensor. After the pressure controller, the pressure sensor is the most important part of the control system. Not any pressure sensor will make the system operate optimally.

The high-performance pressure sensor must be fine-tuned with the pressure controller's PID loop. With the proper set-up, it is possible to maintain a +/- 2% accuracy from the set-point. Simple systems with a variable frequency drive and a pressure sensor will typically work at a +/- 20% accuracy. This type of inaccuracy leads to unnecessary fan speed adjustments and less energy savings. A fan that constantly changes speed will use more energy, create more noise and save a lot less by exhausting more conditioned air than necessary.

Eliminating the pressure controller may represent a minor savings up front, but the return on investment will decline dramatically and the payback will be extended.

Fig. 12 shows the operating characteristics of a pressure controller based system with a high-performance pressure sensor.

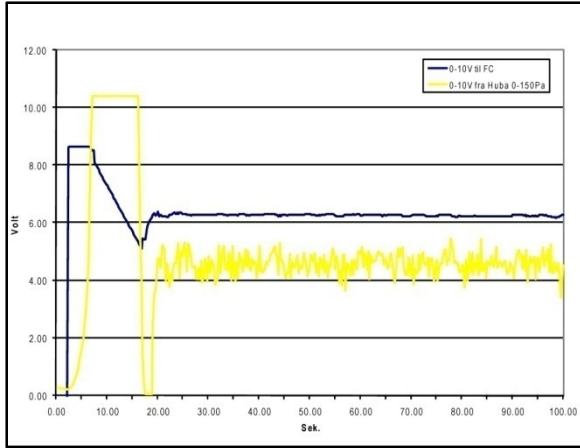


Fig 12: Operating characteristics of a high-performance pressure sensor.

Fig. 13 shows the operating characteristics of a pressure controller/variable frequency drive based system with a standard pressure sensor.

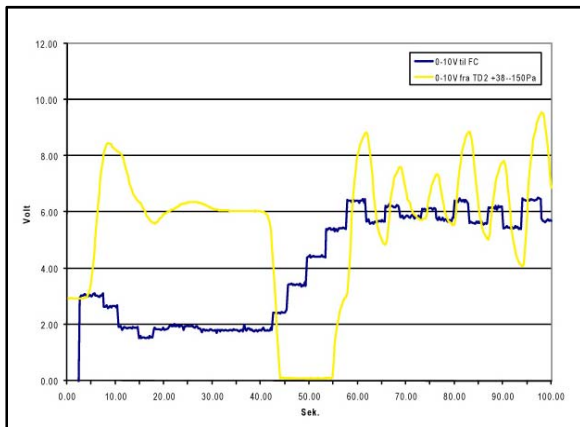


Fig 13: Operating characteristics of a standard pressure sensor.

Fig 12 and 13 shows the operating characteristics of two differently controlled DCV systems when starting a fan from zero. The yellow curves show how well and how often the pressure sensor reads. The closer the distance is between vertical lines, the better it reads.

The blue curves show the quality of the signal sent to the variable speed controller. The flatter the curve is, the better the signal and fine-tuning of the pressure sensor versus the pressure controller. A curve as shown in Fig.13 indicates that fan hunting

will be an issue and the system will be over-exhausted and under-exhausted on a regular basis.

It is also important to observe how fast the controller finds the set-point (see blue curves). The faster the better. In above examples, Fig. 12 finds the set-point in about 20 seconds where it takes about 60 seconds in Fig. 13.

The difference in operating characteristics of the two curves in Fig. 12 and Fig. 13 represents energy savings in favor of the system shown in Fig. 12. These savings can amount to as much as 20%, so an up front material savings can have a major negative impact on the payback and the ROI. Using our State of Maryland example, possible up front savings from using a standard pressure sensor probably amount to \$5-6,000. If the in-accuracy of the standard sensor amounts to a 20% energy loss, the, the payback is now 26 months, the simple 5-year ROI is 138% and 27% annually. It is simply not worth going with a less sophisticated alternative.

Life-Cycle and Maintenance Benefits of DCV

Like all building system decisions, you must examine ventilation options based on a number of building characteristics. The main factors affecting the selection of ventilation system include: (1) design and environmental considerations, (2) installation and renovation logistics, (3) ongoing productivity and flexibility considerations, (4) ongoing maintenance, and (5) reclamation and after-use options.

These factors describe the *measurable lifetime return* on a ventilation system. This is different from *life-cycle cost analysis*, or LCA, which may include a "cradle-to-grave" examination of the product's anticipated use. Measurable lifetime return is a financial measurement similar to *lifetime value* and *return on investment (ROI)*, which describe the net cost advantage of employing a specific ventilation system.

To study LCA accurately requires significant investments in data gathering and analysis. Analyzing measurable lifetime return is more

straightforward. The building team must study the life of the system in question, including its initial costs, installation requirements, typical maintenance measures, and disposal options. Basic financial information about the building where the system is used must also be known, such as cost of maintenance labor.

In general, DCV systems can provide an excellent measurable lifetime return because they tend to save a huge amount of energy and require little maintenance.

DCV Lifetime Return

Given the importance of life-cycle considerations and measurable lifetime return in ventilation system selection, it is useful to assess the performance of ventilation systems in these fundamental terms.

Studies show that DCV require less energy and maintenance cost over the life of the products:

Product description. As an example of these life-cycle advantages, EXHAUSTO's DCV systems are engineered for heavy-use applications. The fans are made in heavy duty galvanized steel and insulated for lower noise levels. Motors are high-quality TEFC motors with inverter duty, variable speed, low-energy features. Typical applications include educational facilities (schools, colleges etc.), hotels/resorts, sports facilities, and vertical subdivisions.

Preparation, installation and construction. The use of DCV can affect the cost of the construction or renovation phase. Less material may go into the construction of shafts and ducts. No special installation tools are required. Retrofit installations can usually take advantage of existing materials such as roof curbs and power supply.

Requirements for maintenance and operations. The DCV requires only minor maintenance costs such as regular cleaning of ducts and the fan interior. An access door that can be opened to provide full access to the fan casing and the duct makes cleaning easier. Direct-drive motors also eliminate the maintenance associated with belt-driven fans

such as belt-replacement, belt-slippage etc. Regular electrical power is required for the operation.

Building operations and human factors. DCV systems rarely interfere with the general building operation. The very low noise level improves occupant comfort dramatically over other ventilation options. DCV systems also reduce or eliminate problems with low pressure zones and draft, which further improves IAQ.

Reclamation, recycling and disposal. End-of-life scenarios for DCV systems include reclamation and recycling. Generally speaking all parts and components of fans can be recycled. The most significant advantage of DCV and most other ventilation systems is source reduction. The end-of-life impact is often very small as compared to the ability to reduce the source: newly manufactured ventilation products.

Calculating the Lifetime Return of Ventilation Choices

Economic elements that impact the ventilation system investment are:

Cost avoidance

- Energy savings
- Product life-cycle increase
- Maintenance savings

Health & safety

- Air quality
- Thermal comfort
- Comfort

As shown in Fig. 14, over a 15 year period a typical demand controlled ventilation system serving eight dryers costs 55% less to operate than a constant speed system. In addition it saves 85% of the cost of exhausting conditioned air.

The graphs in fig. 14 below are based on 2009-energy prices. It is clearly the savings from exhausting less conditioned air that make the DCV system very attractive. But fan operating savings are attractive as well.

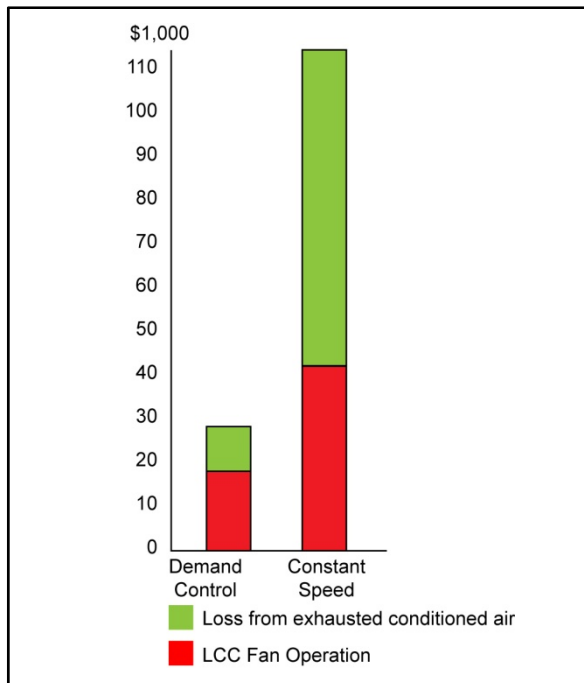


Fig 14: Lifecycle cost of demand controlled versus constant speed ventilation systems

Sustainability and DCV

As awareness of sustainability and green building grows, so does the demand for products and projects which score points and ratings in the LEED Building Rating System created by the U.S. Green Building Council. Building teams that specify DCV can apply for points under the categories Energy & Atmosphere (EA), Indoor Environmental Quality (IEQ) and Innovation & Design Process (IP). Projects can acquire points as follows:

Energy & Atmosphere (EA)

- Minimum energy performance
- Optimize energy efficiency

Indoor Environmental Quality (IEQ)

- Minimum IAQ performance
- Increased ventilation
- Controllability of systems, thermal comfort
- Thermal comfort design

DCV and Incentives

Because of the large potential for energy savings, DCV systems usually qualify for grants or incentives from local state and federal governments. Other sources for incentives are local utilities and Energy Trusts.

DSIRE, which was established in 1995 and funded by the U.S. Department of Energy, is a good source for available incentive programs nationwide. The website is: <http://www.dsireusa.org/>

Special Building Code Considerations

When designing a DCV system, or any other ventilation system, it is strongly recommended to consult the local building and mechanical codes.

The recently published 2009 International Fuel Gas Code introduced major changes to the exhausting requirements for clothes dryers located in multistory structure. The most important change is the addition of Section 614.8, Common exhaust systems for clothes dryers located in multistory buildings.

The code allows residential clothes dryers to be exhausted via a single shaft. The lack of this statement in earlier codes has resulted in many misunderstandings. It further requires that:

- The ductwork within a shaft cannot have offsets.
- The exhaust fan motor shall be located outside of the airstream.
- The exhaust fan shall run continuously, and shall be connected to a standby power source.
- The exhaust fan operation shall be monitored in an approved location and shall initiate an audible or visual signal when the fan is not in operation.

For the complete code text, please refer to the 2009 International Fuel Code, Section 614.

Credits and Sources

The following groups or organizations have been cited or quoted in the development of this white paper.

Enbridge Gas Distribution
International Code Council
Natural Gas Technologies Center

About EXHAUSTO

EXHAUSTO specializes in demand-controlled ventilation for heating appliances, clothes dryers, kitchens and baths. With 50 years of experience, EXHAUSTO has developed a reputation worldwide for integrating deep technical and functional capabilities with design expertise to provide ventilation solutions that deliver profitable, reliable, and sustainable results.

